


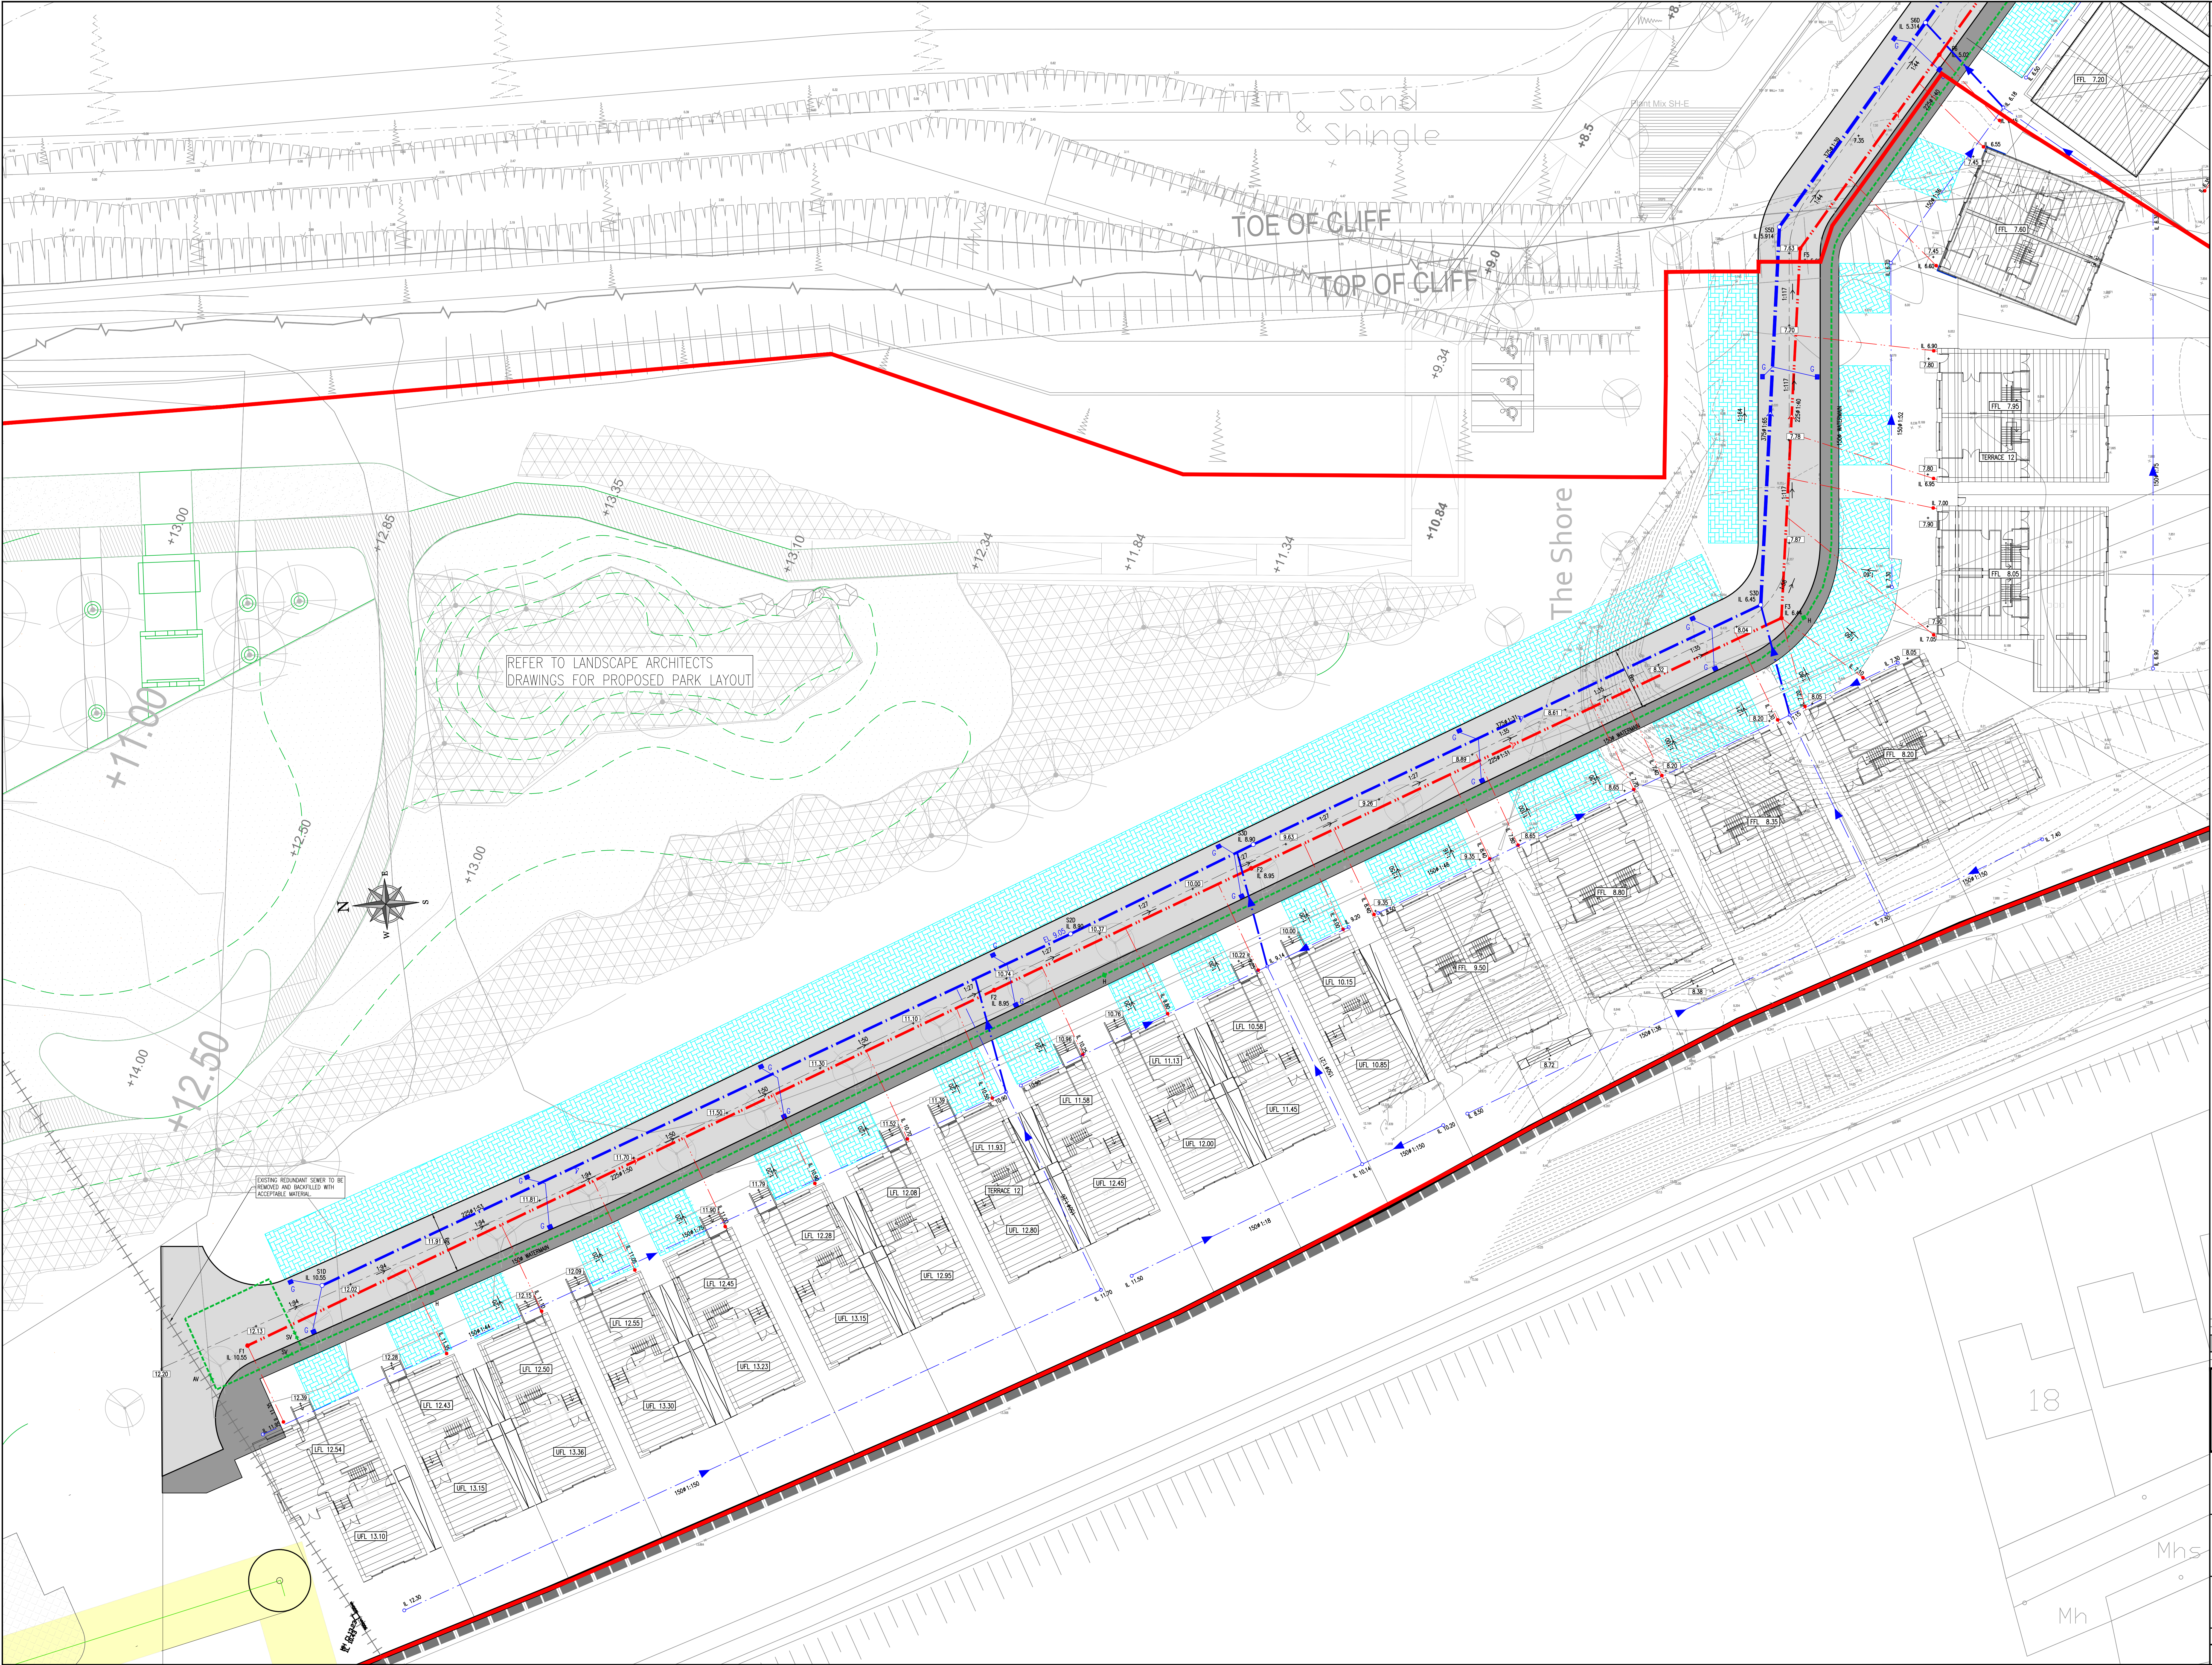

© COPYRIGHT OF THIS DRAWING IS RESERVED BY DBFL CONSULTING ENGINEERS. NO PART SHALL BE REPRODUCED OR TRANSMITTED WITHOUT THEIR WRITTEN PERMISSION.

ON ORIGINAL

0 5 10 20 30 40 50m

NOTES:

1. ALL DRAWINGS TO BE CHECKED BY CONTRACTOR ON SITE AND DIMENSIONS INFORMED OF DISCREPANCIES BEFORE WORK COMMENCES.
2. ALL DIMENSIONS AND LEVELS ARE IN METRES UNLESS NOTED OTHERWISE.
3. ALL LEVELS ARE IN METERS AND ARE RELATED TO ORDNANCE DATUM. CO-ORDINATES RELATE TO NATIONAL GRID.
4. CONTRACTOR SHALL SATISFY HIMSELF AS TO THE ACCURACY OF PAVED LEVELS ON SITE PRIOR TO COMMENCEMENT OF WORKS ON SITE.
5. ALL FLOOR SLOPES TO BE CONCRETE OR UPVC.
6. ALL SURFACE WATER SLOPES TO BE 225 DIA. MINIMUM CLASS H CONCRETE.
7. ALL EXTERNAL HOUSE DRAINS TO BE 100mm DIAMETER.
8. FALLS IN FOUL HOUSE DRAINS TO BE 1:80 UNO.
9. LOCATION AND INVERT LEVELS OF EXISTING MANHOLES OR CATCHPITS, WHERE APPLICABLE, TO BE NOTED BY CONTRACTOR PRIOR TO COMMENCEMENT OF DRAINAGE WORKS.
10. ALL WATERMANS SHALL BE 100mm/150mm PVC-A MAIN ADOPTED (MINIMUM TO BAY) EXCEPT UNDER ROADWAYS WHERE SLOTTED IRON IS TO BE USED.
11. AT 90 DEG. TURNS USE 2 No. 45 DEG. BENDS.
12. COVER TO WATERMAIN TO BE 800mm.
13. SPOOT SOCKET CONNECTIONS TO BE USED AT UPVC/DUCTILE IRON JUNCTIONS.
14. ANCHOR BLOCKS TO BE PROVIDED AT HEAD ENDS, TEES, BENDS AND AT EACH SIDE OF HYDRANTS AND VALVES.
15. HYDRANT OUTLET TO BE 300mm BELOW GROUND LEVEL UNLESS REQUESTED OTHERWISE.
16. ALL CONNECTIONS TO COMPLY WITH THE REQUIREMENTS OF THE LOCAL AUTHORITY.
17. CONTRACTOR TO INCLUDE FOR ADJUSTING ALL EXISTING MANHOLE, VALVE COVERS, ETC. WITHIN LIMITS OF WORKS TO NEW LEVELS.
18. ALL COVER LEVELS TO MATCH FINISHED ROAD/VERGE/FOOTPATH/CYCLOTRACK LEVELS UNLESS OTHERWISE SITED.
19. ALL DRAINAGE WORKS/CONNECTIONS TO COMPLY WITH THE REQUIREMENTS OF THE LOCAL AUTHORITY.
20. CONTRACTOR TO INCLUDE FOR CCTV SURVEY OF ALL SEWERS UPON COMPLETION OF SAME.

LEGEND:

PROPOSED SERVICES:

- 100mm WATERMAIN
- 150mm WATERMAIN
- 150mm FIRE HYDRANT
- 150mm SLUCE VALVE
- 150mm AIR VALVE
- 150mm WATER METER
- 150mm FINISHED FLOOR LEVEL
- 150mm APPLICATION BOUNDARY

EXISTING SERVICES:

- EXISTING WATERMAIN
- EXISTING FIRE HYDRANT
- EXISTING SLUCE VALVE
- EXISTING WATER METER

REV.	DATE	DESCRIPTION	BY	CHKD
DESIGNED	CHD	PREPARED	GRAC	
DATE	Nov017	CHECKED	DJR	

FOR INFORMATION

DBFL

DBFL Consulting Engineers Ltd. The Chantry,
110 O'Connell Street, Dublin 1, Ireland.
Phone: +353 1 400 4000
Fax: +353 1 400 4001
Email: info@dbfl.ie or www.dbfl.ie

PROJECT:
**RESIDENTIAL DEVELOPMENT
AT GREYSTONES MARINA,
CO. WICKLOW**

DWG. TITLE:
**PART 8
SITE SERVICES
LAYOUT**

CLIENT:
**WICKLOW COUNTY COUNCIL,
GREYSTONES DEVCO
AND SISK**

SCALE: 1:200 (A4) FILE REF: 152076-01/10
DWG. NO: 152076-3150