


DON'T SCALE DIMENSIONS

Health and Safety:

THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS, THE SPECIFICATION AND THE SAFETY AND HEALTH PLAN.


THE APPOINTMENT OF THE PROJECT SUPERVISOR DESIGN PROCESS IS THE CLIENT'S RESPONSIBILITY.

TEMPORARY WORKS PROPOSALS AND/OR METHOD STATEMENTS TO BE SUBMITTED TO THE PSDP AND THE PSSS FOR WORKS WHICH INVOLVE PARTICULAR RISKS.

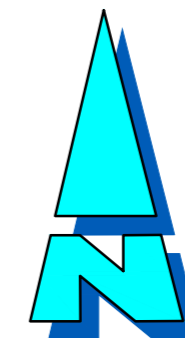

Notes:

1. NO PART OF THIS DRAWING MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR STORED IN ANY RETRIEVAL SYSTEM OF ANY NATURE WITHOUT THE WRITTEN PERMISSION OF MALONE O'REGAN CONSULTING ENGINEERS AS COPYRIGHT HOLDER EXCEPT AS AGREED FOR USE ON THE PROJECT FOR WHICH THE DRAWING WAS ORIGINALLY ISSUED.
2. THE APPOINTMENT OF THE PROJECT SUPERVISOR DESIGN PROCESS IS THE CLIENT'S RESPONSIBILITY.
3. ALL DIMENSIONS IN mm UNLESS NOTED OTHERWISE.
4. THE CONTRACTOR SHALL CHECK ALL DIMENSIONS PRIOR TO COMMENCEMENT OF CONSTRUCTION. DISCREPANCIES SHALL BE REPORTED TO THIS OFFICE IN WRITING.
5. THIS DRAWING TO BE READ IN ACCORDANCE WITH ALL RELEVANT ENGINEERS' DRAWINGS AND SPECIFICATIONS.

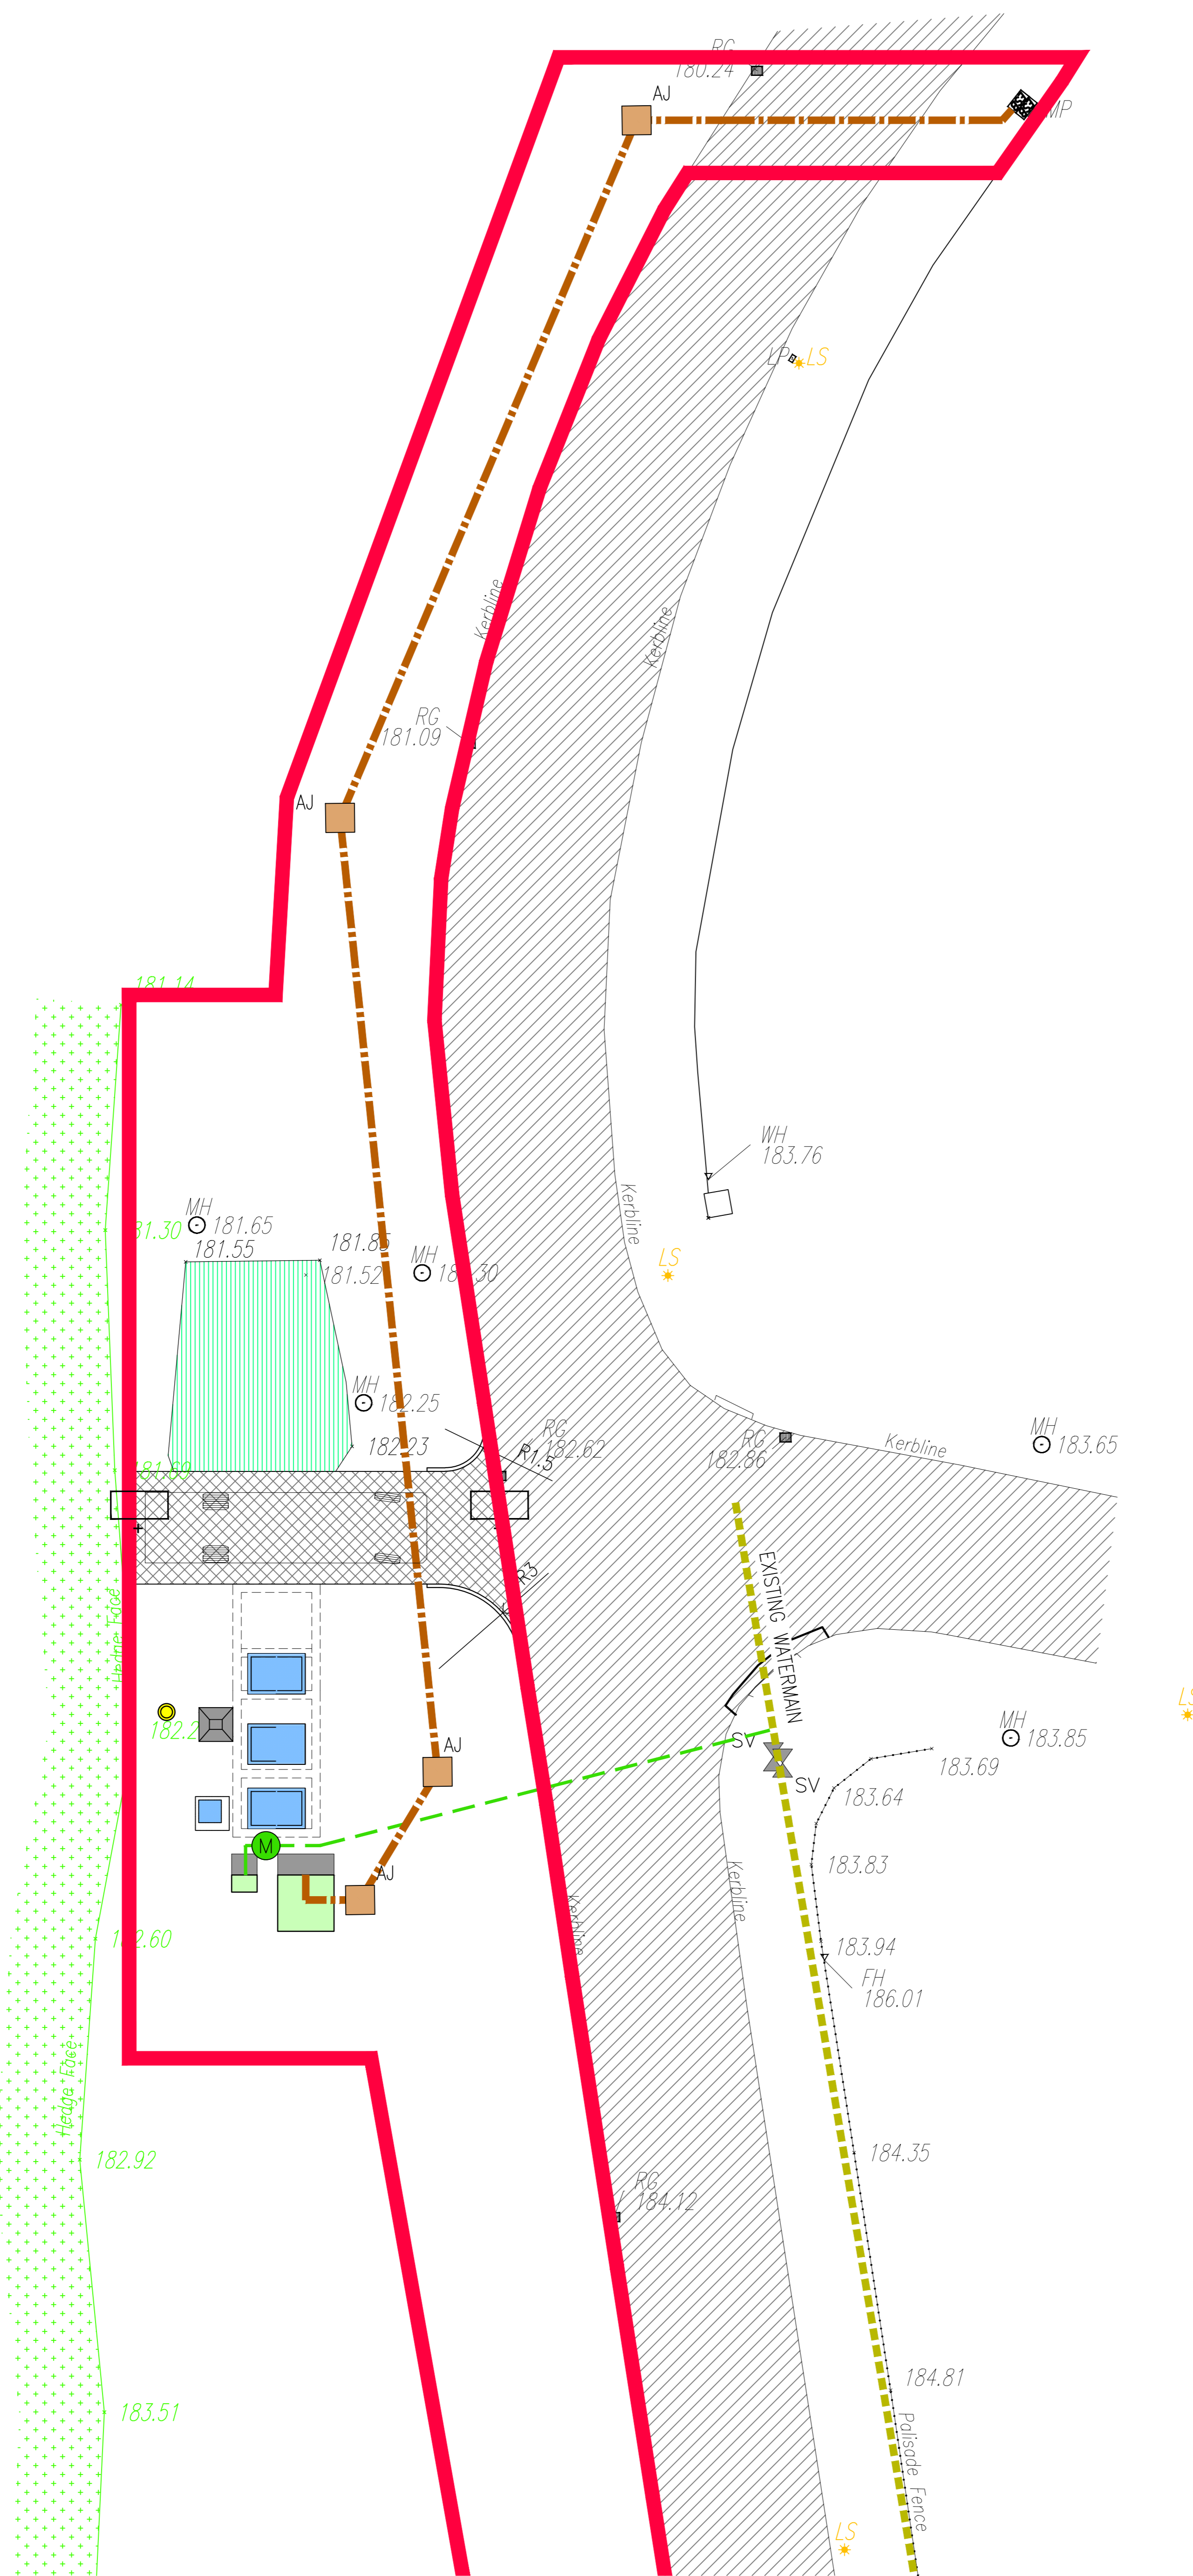

LEGEND

- PROPOSED ELECTRICAL DUCT WORK:**
- 1No. 100mm ϕ ELEC DUCT (INCOMING ESB)
 - 1 No. 50mm ϕ EARTH CABLE DUCT
 - 2No. 100mm ϕ CABLE DUCT (FOR PUMPS)
 - 1No. 100mm ϕ CABLE DUCT FOR ULTRASONIC LEVEL SENSOR AND FLOAT SWITCH
 - 1No. 100mm ϕ CABLE DUCT FOR FLOW METER SENSOR
- PROPOSED ELECTRICAL AJ CHAMBER AT EVERY CHANGE OF DUCTWORK DIRECTION (WATERPROOF PLASTERED BLOCKWORK)**
- PROPOSED 25mm (O.D.) P.E. WATERMAIN TO WET KIOSK**
- PROPOSED WATERMETER (BOUNDARY BOX COVER)**

PROPOSED AREA OF SITE 2175m² (0.537 acres OR 0.217 Ha)

DENOTED THUS:

P	PLANNING ISSUE	14.01.2022	PC	COB	COB
Rev.	Description	Date	Drawn	Chkd	Appr

THIS DRAWING TO BE USED FOR PLANNING PURPOSES ONLY

ADR MALONE O'REGAN CONSULTING ENGINEERS

3-4 Canada Street
Waterford
Co. Waterford.
X91 V52K
Tel: +353 51 876 855
Email: waterford@moroe.ie
Web: www.maloneoregan.com

Offices also in:

DUBLIN : Tel: +353 1 260 2655 Email: dublin@moroe.ie
 GALWAY: Tel: +353 91 531 069 Email: galway@moroe.ie
 LONDON: Tel: +44 208 5281685 Email: london@moroe.ie

Client WICKLOW COUNTY COUNCIL

Job DUNLAVIN WASTEWATER TREATMENT PLANT UPGRADE, DUNLAVIN, CO. WICKLOW

Drawing PROPOSED SITE SERVICES

Job No	Drw No	Stage	Revision	Scale
W21077	P804	PL	P	A1 1:125 A3 1:250

DON'T SCALE DIMENSIONS