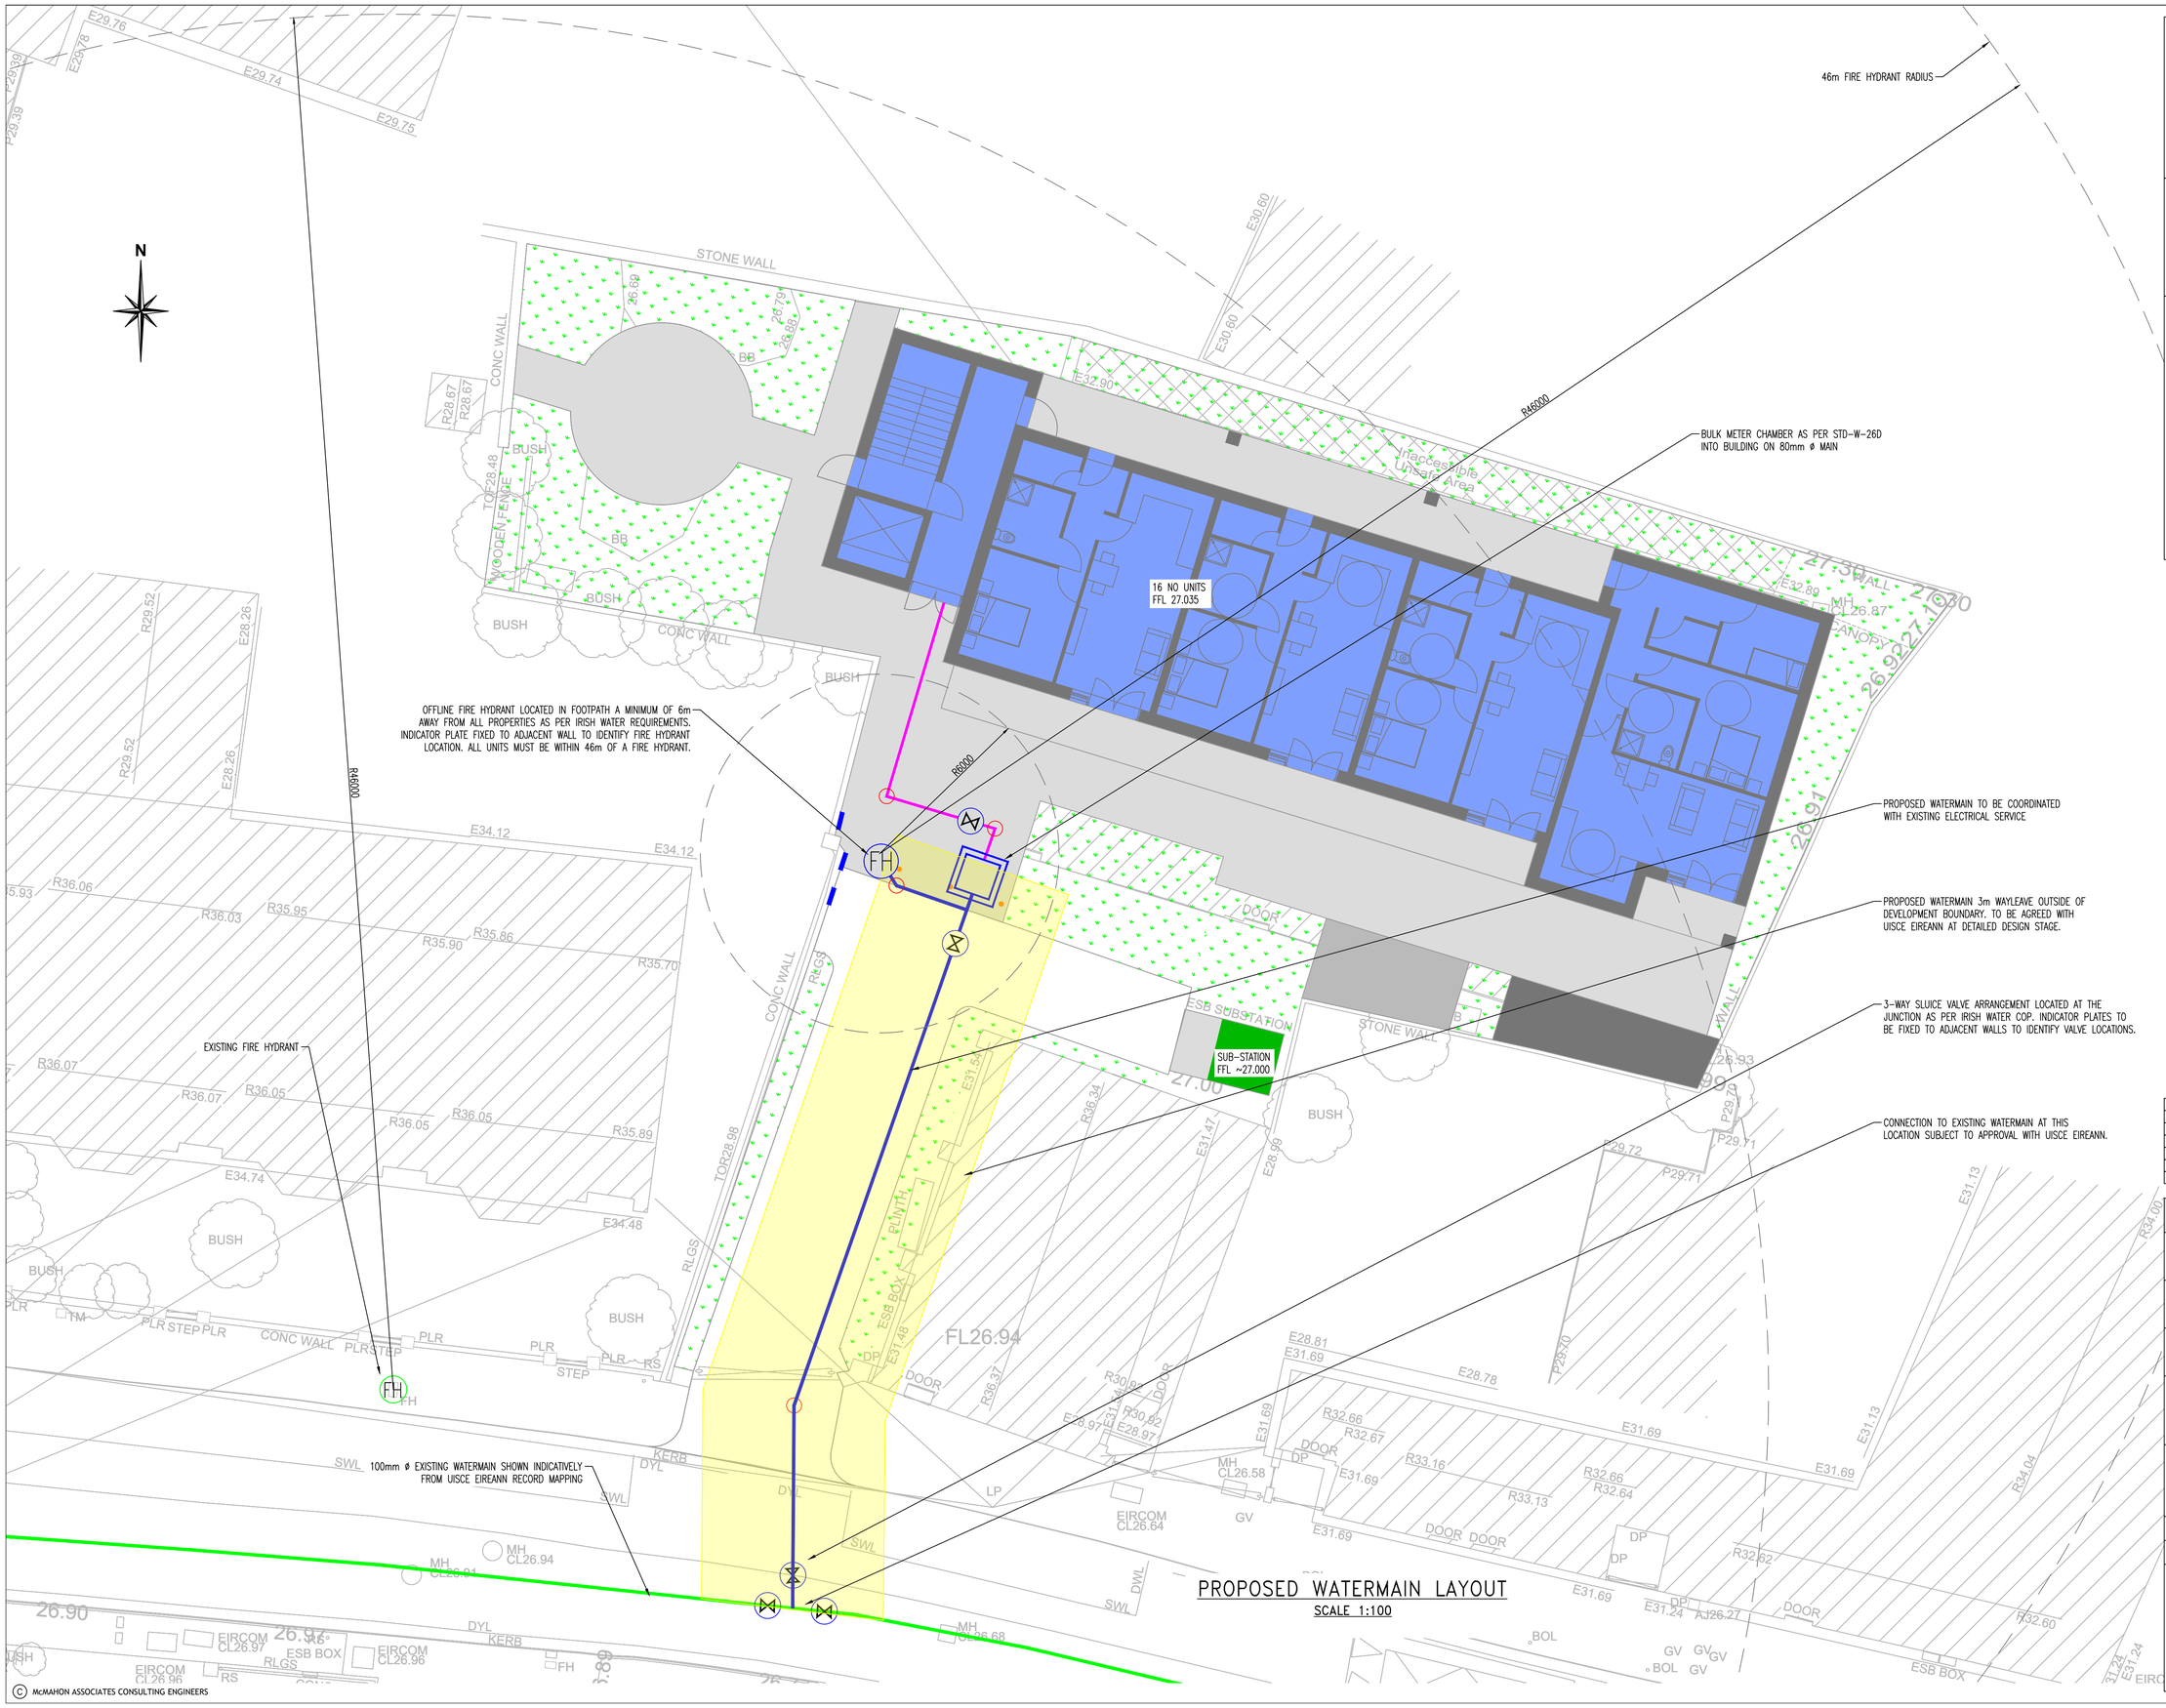

PROPOSED WATERMAIN LAYOUT

SCALE 1:100

GENERAL NOTES:

1. ALL DIMENSIONS AND LEVELS TO BE VERIFIED ON SITE PRIOR TO COMMENCEMENT OF THE WORKS. ANY DISCREPANCIES TO BE REPORTED TO THE ENGINEER.
2. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE RELEVANT ARCHITECT'S AND OTHER ENGINEERING DRAWINGS.

WATERMAIN NOTES:

1. ALL WATERMAINS AND SUPPLY SHOULD BE CONSTRUCTED TO IRISH WATER REQUIREMENTS AND IN ACCORDANCE WITH IRISH WATER CONNECTIONS & DEVELOPER SERVICES WATER INFRASTRUCTURE STANDARD DETAILS IW-CDS-5020-01 AUGUST 2025 REVISION 5.

WATERMAIN LAYOUT LEGEND

- EXISTING 100mm ø WATERMAIN
- EXISTING FIRE HYDRANT
- PROPOSED SLUICE VALVE
- PROPOSED WATERMAIN 100mm I.D PE PIPE
- PROPOSED WATERMAIN 80mm I.D PE PIPE CONNECTION
- PROPOSED FIRE HYDRANT
- PROPOSED INDICATOR PLATE
- PROPOSED THRUST BLOCK
- WATERMAIN 3m WAYLEAVE

REV	DATE	DESCRIPTION	BY	APPR.

DRAWING STATUS: PART_8_PLANNING

CLIENT: WICKLOW COUNTY COUNCIL

ARCHITECT: WICKLOW COUNTY COUNCIL

JOB DESCRIPTION: 16 NO. UNIT APARTMENT DEVELOPMENT, PARNELL ROAD, BRAY, CO. WICKLOW

DRAWING TITLE: PROPOSED WATERMAIN LAYOUT

PROJECT No.:		DRAWING No.:
P-3953		C-03
		REV. No.: -
SCALE: 1:100	SHEET: A1	DATE: 19.03.26
DRAWN BY: SMC	CHECKED BY: PMG	APPROVED BY: MK

McMahon Associates
Consulting Civil & Structural Engineers, Project Managers
Environmental Engineers, PSDP & Traffic Engineers
The Mill Building, Newtown Link Road, Greenhills, Drogheda, Co. Louth
t: 041 4141 383 e: info@mcmahonengineers.com

© McMAHON ASSOCIATES CONSULTING ENGINEERS